

# UMC800 Boiler Control

Industry: General

Application: Drum Level Control and Fuel Air Ratio Control

## Background

Until recent years, only the largest boilers could justify sophisticated boiler controls. Now high fuel costs and occasional limited fuel availability make it necessary to improve boiler efficiency and minimize costly steam losses and disturbances.

Government regulations force compliance with air pollution and safety standards. Combustion controls have also become more important because boiler loads are being varied to meet needs rather than operating at full capacity and wasting fuel and steam.

Similar concerns are causing the metals processing and heat treating industries to improve control for their furnaces and other fuel fired processes.

## Solution

Modern controls such as the UMC800 can provide the most efficient boiler operation.

**Drum Level Control.** The steam drum is an integral part of a boiler. The vessel's primary function is to provide a surface area and volume near the top of the boiler where separation of steam from water can occur. It also provides a location for chemical water treatment, addition of feedwater, recirculation water, and blowdown.

Blowdown removes residue and maintains a specified impurity level to reduce scale formation. Because these functions involve the continual addition and loss of material, the water-steam interface level is critical.

Low level affects the recirculation of water to the boiler tubes and reduces the water treatment effectiveness.

High level reduces the surface area and can lead to water and dissolved solids entering the steam distribution system.

The objective of the drum level control system is to maintain the water-steam interface at the specified level and provide a continuous mass balance by replacing every pound of steam with a pound of feedwater.

**Types of Drum Level Control.** There are three basic types of drum level control systems: single element, two element and three element. Their application depends upon specific boiler size and load changes.

The **Single Element System** is the simplest approach. It measures level and regulates feedwater flow to maintain the level. This is only effective for smaller boilers supplying steady processes which have slow and moderate load changes.

The **Two Element System** uses two variables, drum level and steam flow to manipulate the feedwater flow.

Steam flow load changes are fed forward to the feedwater valve providing an initial correction for load changes. The steam flow range and feedwater flow range are matched so that a one pound change in steam flow results in a one pound change in feedwater flow.

This system is adequate for load changes of moderate speed and magnitude and can be applied to any size boiler.

It does have two drawbacks. It cannot adjust for pressure or load disturbances in the feedwater system and cannot adjust for phasing interaction in the process because only the relatively slow responding drum level is controlled.

## Types of Drum Level Control. continued

The **Three Element System** adds a third variable, feedwater flow rate to manipulate the feedwater control valve. This system provides close control during transient conditions because the two controllers minimize phasing interaction present in the two element approach. The feedwater control assures an immediate correction for feedwater disturbances. The drum level control provides trimming action. This system can handle large

and rapid load changes and feedwater disturbances regardless of boiler capacity. This approach is required on multiple boilers having a common feedwater supply. It is ideal for plants with both batch and continuous processes where sudden and unpredictable steam demand changes are common.

Figure 1 shows a Drum Level Control Solution implemented with the LeaderLine Control Builder Software.

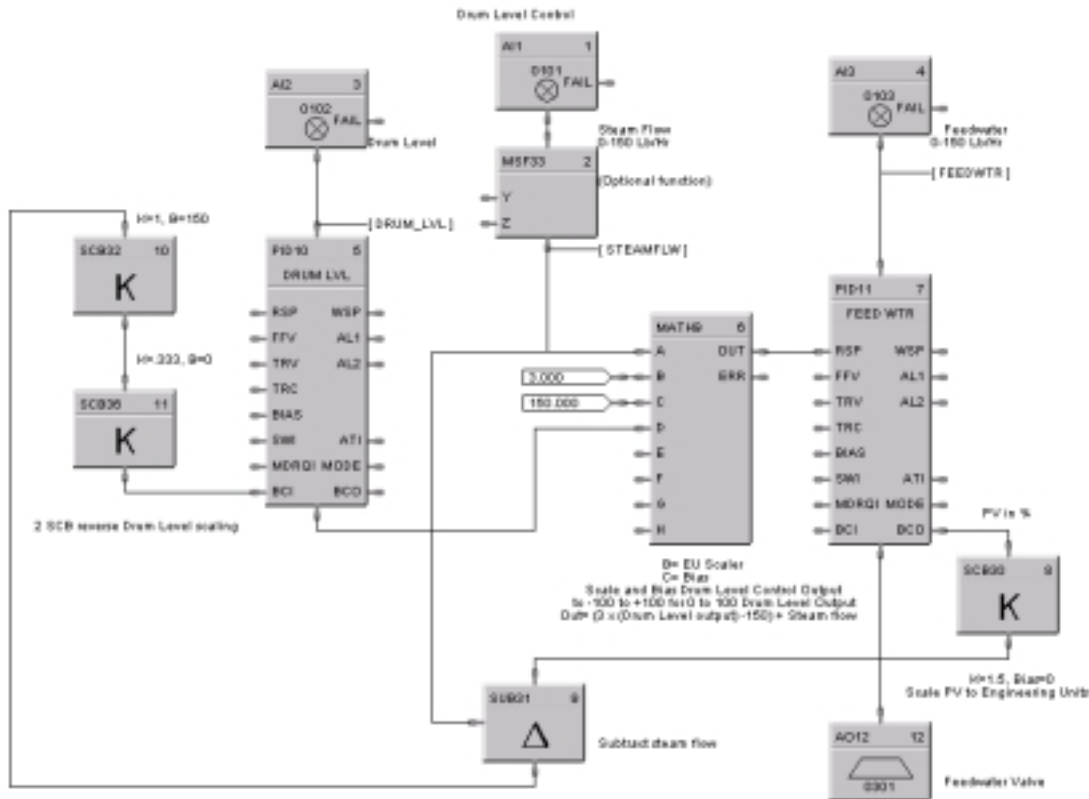


Figure 1 – Drum Level Control Solution

**Fuel-Air Ratio Control.** A fuel-air metering control system is essential for efficient combustion in boilers, furnaces, and other large fuel fired heating processes. There are three basic types of Fuel-Air Ratio control systems: series metered system, parallel metered system, and cross limiting system.

The **Series Metered System** is fairly common where load changes are not large or common. Both fuel and air are metered. The steam pressure controller regulates the fuel flow which is measured, linearized and then is ratioed and used as the remote set point to the air flow controller. This positions an air damper to maintain the specified ratio between the fuel and air.

This system is adequate for near steady state conditions. However lags in response to load changes can result in temporary smoking, incomplete combustion and fuel-rich conditions.

## Fuel-Air Ratio Control, continued

The **Parallel Metered System** operates the fuel and air control controllers in parallel from a setpoint generated by the steam pressure controller. The setpoint signal is ratioed before being used as the setpoint to the air controller to establish the fuel-air proportions. This system relies on similar responses from both controllers to prevent improper fuel-air mixtures. This system is best applied to processes which experience relatively slow load changes.

The **Cross Limiting System** is used when large or frequent load changes are expected.

This is a dynamic system which helps compensate for the different speed of response of the fuel valve and air damper. It prevents a “fuel-rich” condition and minimizes smoking and air pollution from the stack.

The system is also known as a *lead-lag* system. When demand increases, a low selector blocks then increase forcing the air flow signal to become the setpoint to the fuel flow controller. A high selector passes the increase to the airflow controller’s setpoint. This means fuel flow can not increase until air flow has begun to increase, i.e. **air increase leads fuel increase**.

When demand decreases, the low selector passes the signal to the fuel flow controller setpoint, while the high selector passes the fuel flow signal to the air flow controller setpoint. This means flow can not decrease until the fuel flow begins to drop hence **air decrease lags fuel decrease**. This means a fuel rich condition is avoided, regardless of the direction of load change.

Figure 2 shows a Fuel-Air Ratio Control Solution implemented with the LeaderLine Control Builder Software.

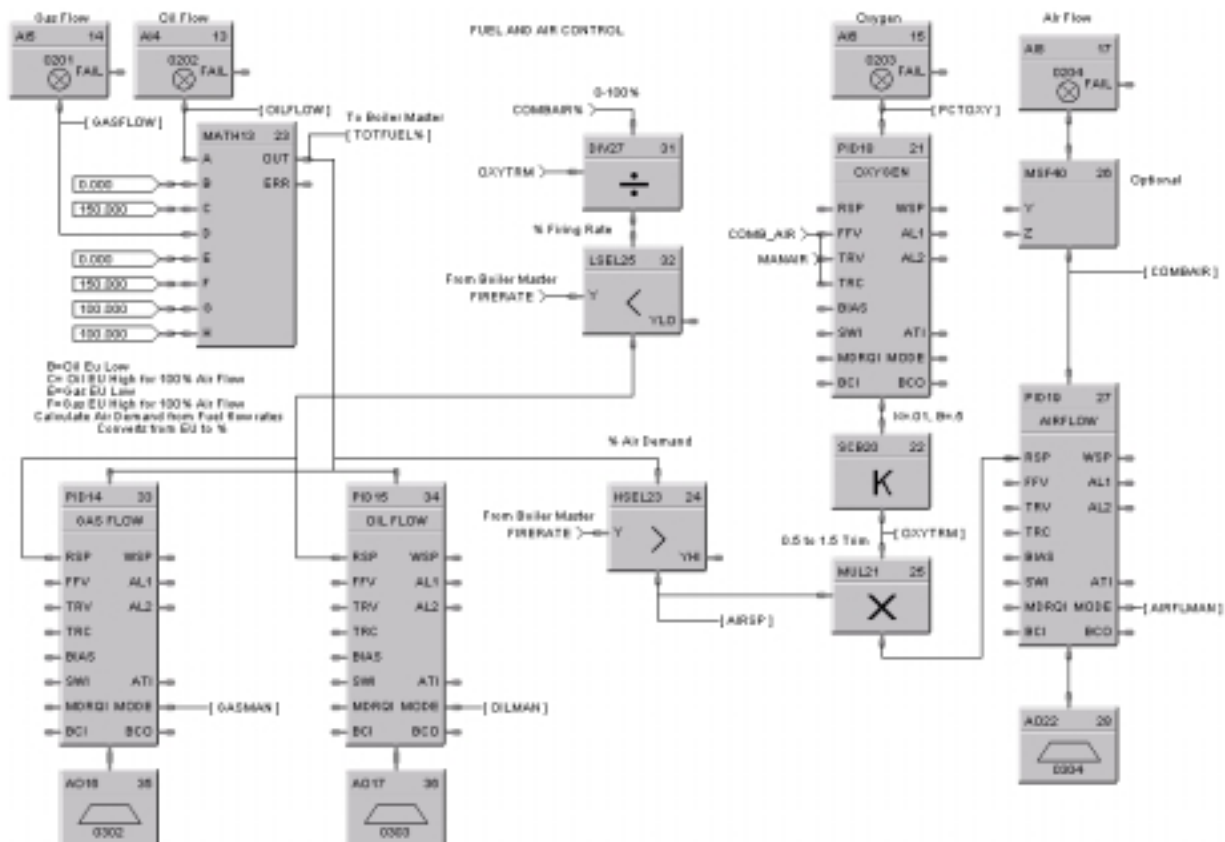


Figure 2 – Fuel-Air Ratio Control Solution

**Oxygen Trim.** Automatic oxygen trim of the fuel-air ratio is used to reduce excess air and thereby excess oxygen to nearly stoichiometric combustion efficiency.

Too much air results in energy lost up the stack. Insufficient air results in loss of heat generation and increased pollution due to incomplete fuel combustion.

A certain amount of excess air is required to insure that complete combustion occurs within

the combustion chamber and to compensate for delays in fuel-air ratio control action during load changes.

In addition to improved efficiency lower excess air helps reduce corrosion and air pollution by minimizing formation undesired gases.

Figure 3 shows a Fuel-Air Ratio Control with Oxygen Trim Solution implemented with the LeaderLine Control Builder Software.

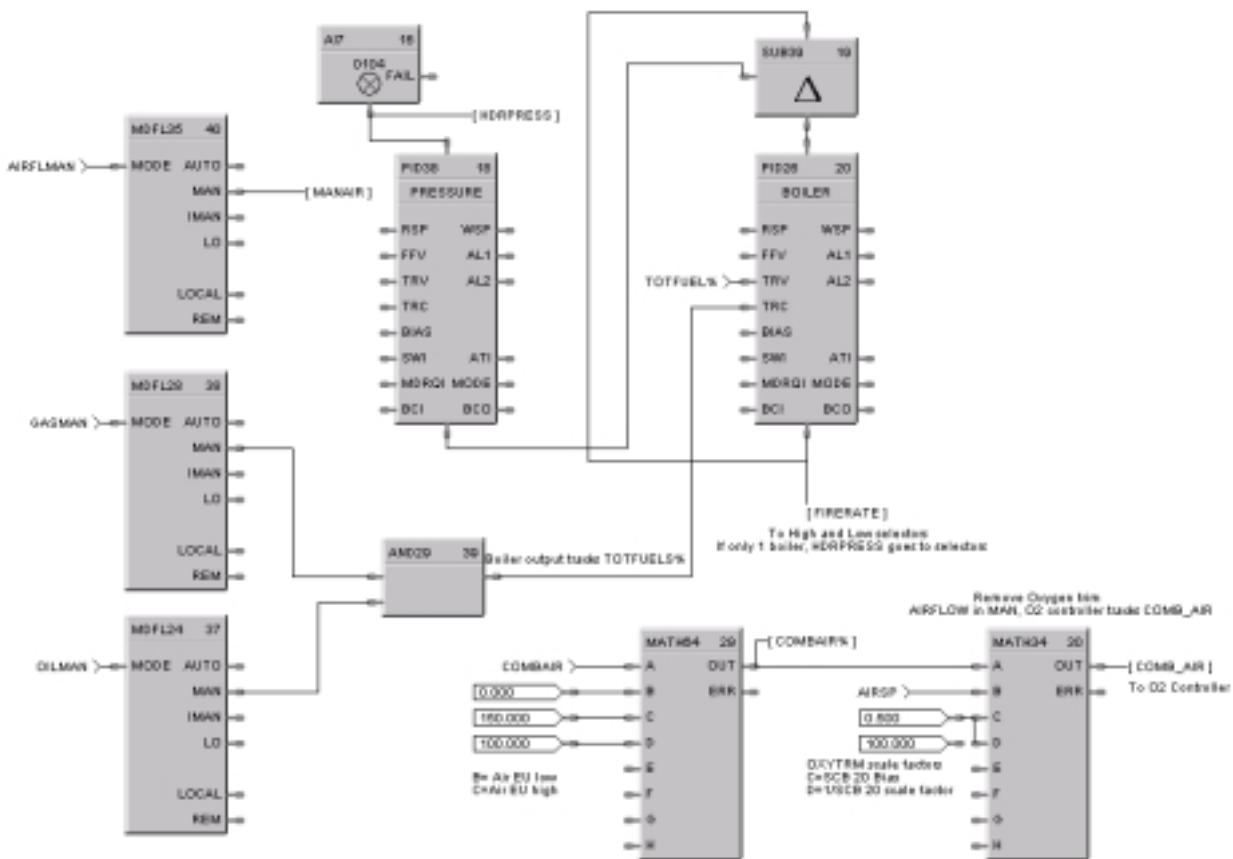


Figure 3 – Fuel-Air ratio with Oxygen Trim Solution

## Benefit Summary

The Honeywell UMC800 provides the following benefits when used in boiler control applications:

- Integrated loop and logic control minimizes equipment cost
- Integrated control and operator interface simplifies troubleshooting
- The ability to trend and log process data for regulatory agency reporting
- A common configuration tool for both control and OI minimizing engineering costs
- Autotuning and fuzzy overshoot protection for quick startup and proper control operation

## Implementation

The UMC800 as shown in Figure 4 consists of a panel-mounted controller connected to a dedicated Operator Interface (OI).



**Figure 4 – UMC800 Controller and OI**

All field signals terminate at the controller.

The controller has universal analog inputs, analog outputs and a wide variety of digital input and output types.

The controller provides all the control functions required for the **drum level control, fuel-air ratio control** and **oxygen trim**.

The boiler operation can be monitored and controlled from the easy to use, familiar displays of the OI.

The data storage feature of the OI can be used to log process information during operation to an integral floppy disk for a permanent record and reporting to regulatory agencies.

The PC based configuration tool simplifies engineering and documentation. Both the control and OI are configured with the same object-oriented drag and drop software simplifying troubleshooting and reducing engineering costs.

### Typical Model Numbers are:

#### **UMC800 Controller**

8001-00B-0E-11230006-00000000-00-0-0

- 8 Universal Analog Inputs
- 4 Analog Outputs
- 6 Digital Inputs, Contact Closure
- 6 Digital Outputs, Relay
- Control Builder Software
- CE, CSA, UL Approval

#### **UMC800 Operator Interface**

8002-0-A0-BE0-100-3-0

- Color LCD Display
- Preformatted Standard Display
- 3.5" Floppy Drive & Data Archiving
- 10 Ft. OI Cable
- CE, CSA, UL Approval
- Data Analysis Software

### WARRANTY/REMEDY

Honeywell warrants goods of its manufacture as being free of defective materials and faulty workmanship. Contact your local sales office for warranty information. If warranted goods are returned to Honeywell during the period of coverage, Honeywell will repair or replace without charge those items it finds defective. The foregoing is Buyer's sole remedy and is **in lieu of all other warranties, expressed or implied, including those of merchantability and fitness for a particular purpose.**

Specifications may change without notice. The information we supply is believed to be accurate and reliable as of this printing. However, we assume no responsibility for its use.

While we provide application assistance personally, through our literature and the Honeywell web site, it is up to the customer to determine the suitability of the product in the application.

For application assistance, current specifications, or name of the nearest Authorized Distributor, check the Honeywell web site or call:

1-800-343-0228 (USA)

### INTERNET

[www.honeywell.com/sensing](http://www.honeywell.com/sensing)

Distributor:

**Honeywell**

**Sensing and Control**  
Honeywell  
11 West Spring Street  
Freeport, Illinois 61032



[www.honeywell.com/sensing](http://www.honeywell.com/sensing)